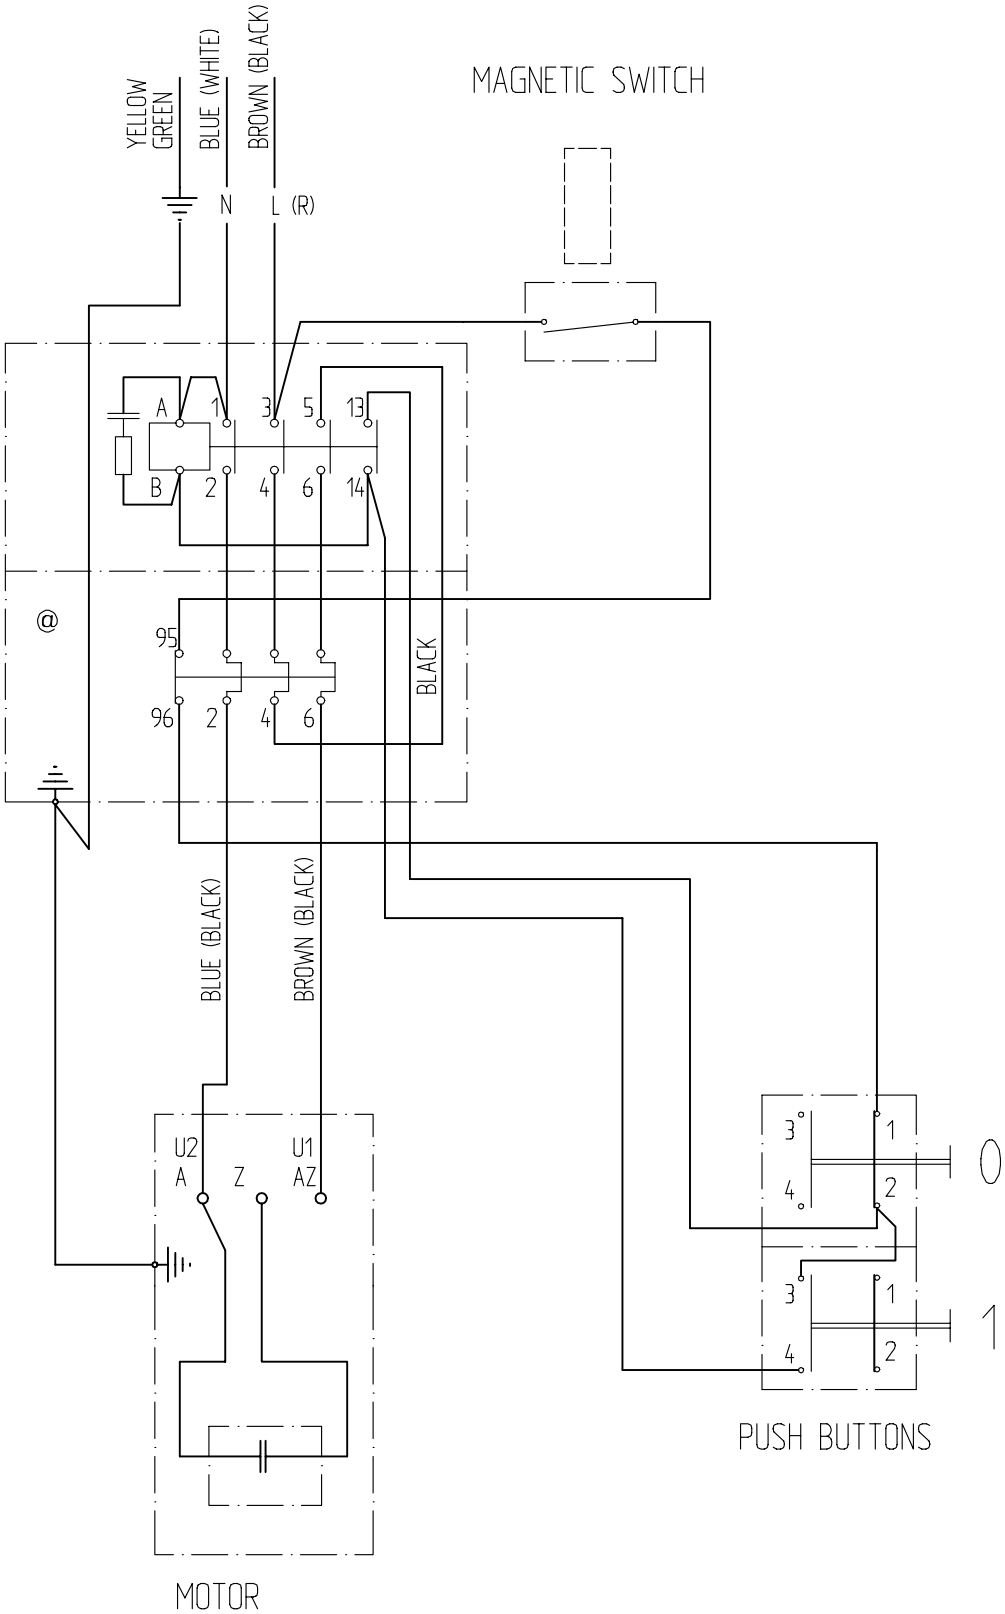

OTHER CABLES RED

@: IMPORTANT: REMOVE CONNECTION PIN 14 AND A2
ON THE OVERLOAD RELAY BEFORE MOUNTING

HALLDE	RG-7, ELECTR. DIAGRAM 110-240 1 50/60	Dwn by UEn	Rev.date 96-02-21
		Appr. JSt	Date 96-02-02
		Drawing no. 80059-2	